



Control unit

For Emotron DSV15-35 AC drives



13506840

Mounting instruction

1 General information

First read, then start

1 General information

1.1 First read, then start



Read this documentation thoroughly before carrying out the installation and commissioning.
Please observe the safety instructions!



You will find information on wiring and commissioning in the mounting and switch-on instructions of the inverter.



Information and tools with regard to the Emotron products can be found on the Internet:
<http://www.emotron.com> à File-archive

2 Mounting

2.1 Important notes

 **DANGER!**

Dangerous electrical voltage

Possible consequence: death or severe injuries

- ▶ All works on the inverter must only be carried out in the deenergised state.
 - ▶ After switching off the mains voltage, wait for at least 3 minutes before you start working.
-

2 Mounting

Mounting steps


2.2 Mounting steps

You need:

- Torx screwdriver TX20


1. **Preparation:**

1. Insert the shield sheet into the slot on the back side until it engages.

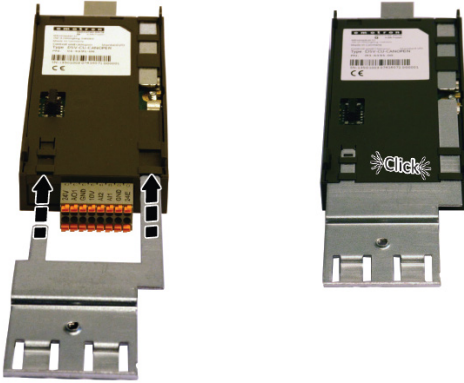


2. **Mounting:**


1. Hook the control unit into the upper mounting slots.

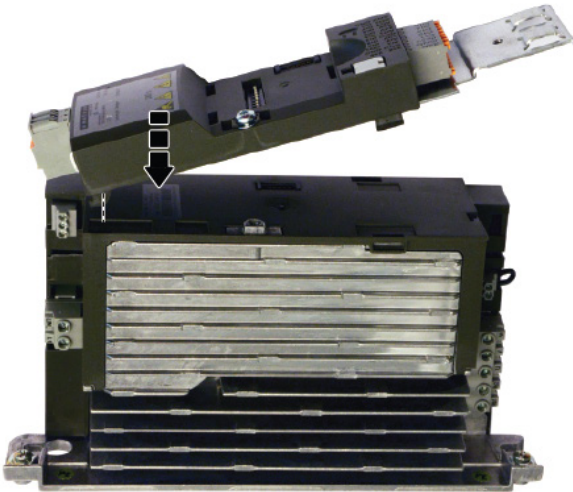

2. Turn it downwards until it engages into the lower mounting slots.

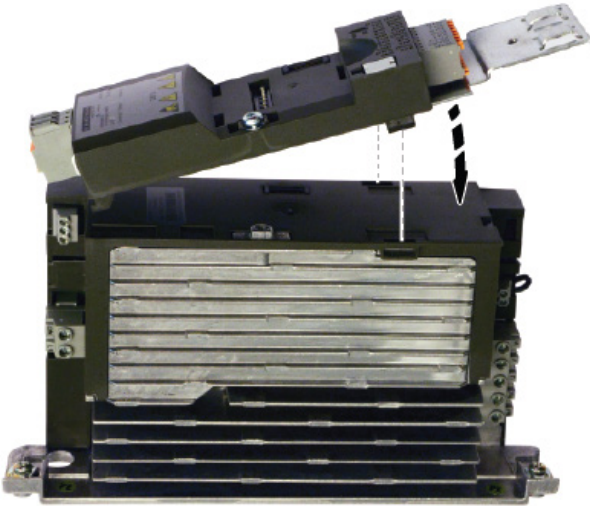

3. Fix it with a securing screw.

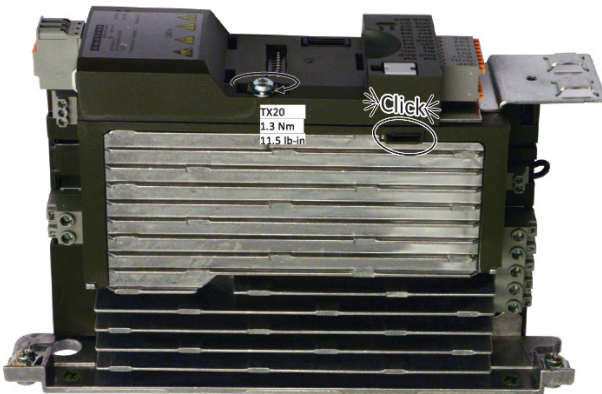

The control unit is mounted.

CG DRIVES & AUTOMATION

Mörsaregatan 12,

Box 222 25

SE- 250 24 Helsingborg,

Sweden

+46 42 16 99 00

Info: info.se@cglobal.com

Order: order.se@cglobal.com